




Spare Parts / Ersatzteile / Pièces de recharge / Pezzi di Ricambio / Piezas de requesto /
Parte de reposição / Reserveonderdelen / Reservdelar / Reservedeler / Varaosat /
Vraosat / Varahlutir / Ανταλλακτικά / Yedek Parçalar / Náhradní díly / Náhradné diely /
Nadomestni deli / Резервни части / Запчасти / Części Zapasowe / Piese de schimb
/ Rendelhető alkatrészek / Запасні частини / Reservni delovi / Резервни делови /
Резервни делови / Atsarginių dalių / Tellitavad varuosad / Rezervju daļu

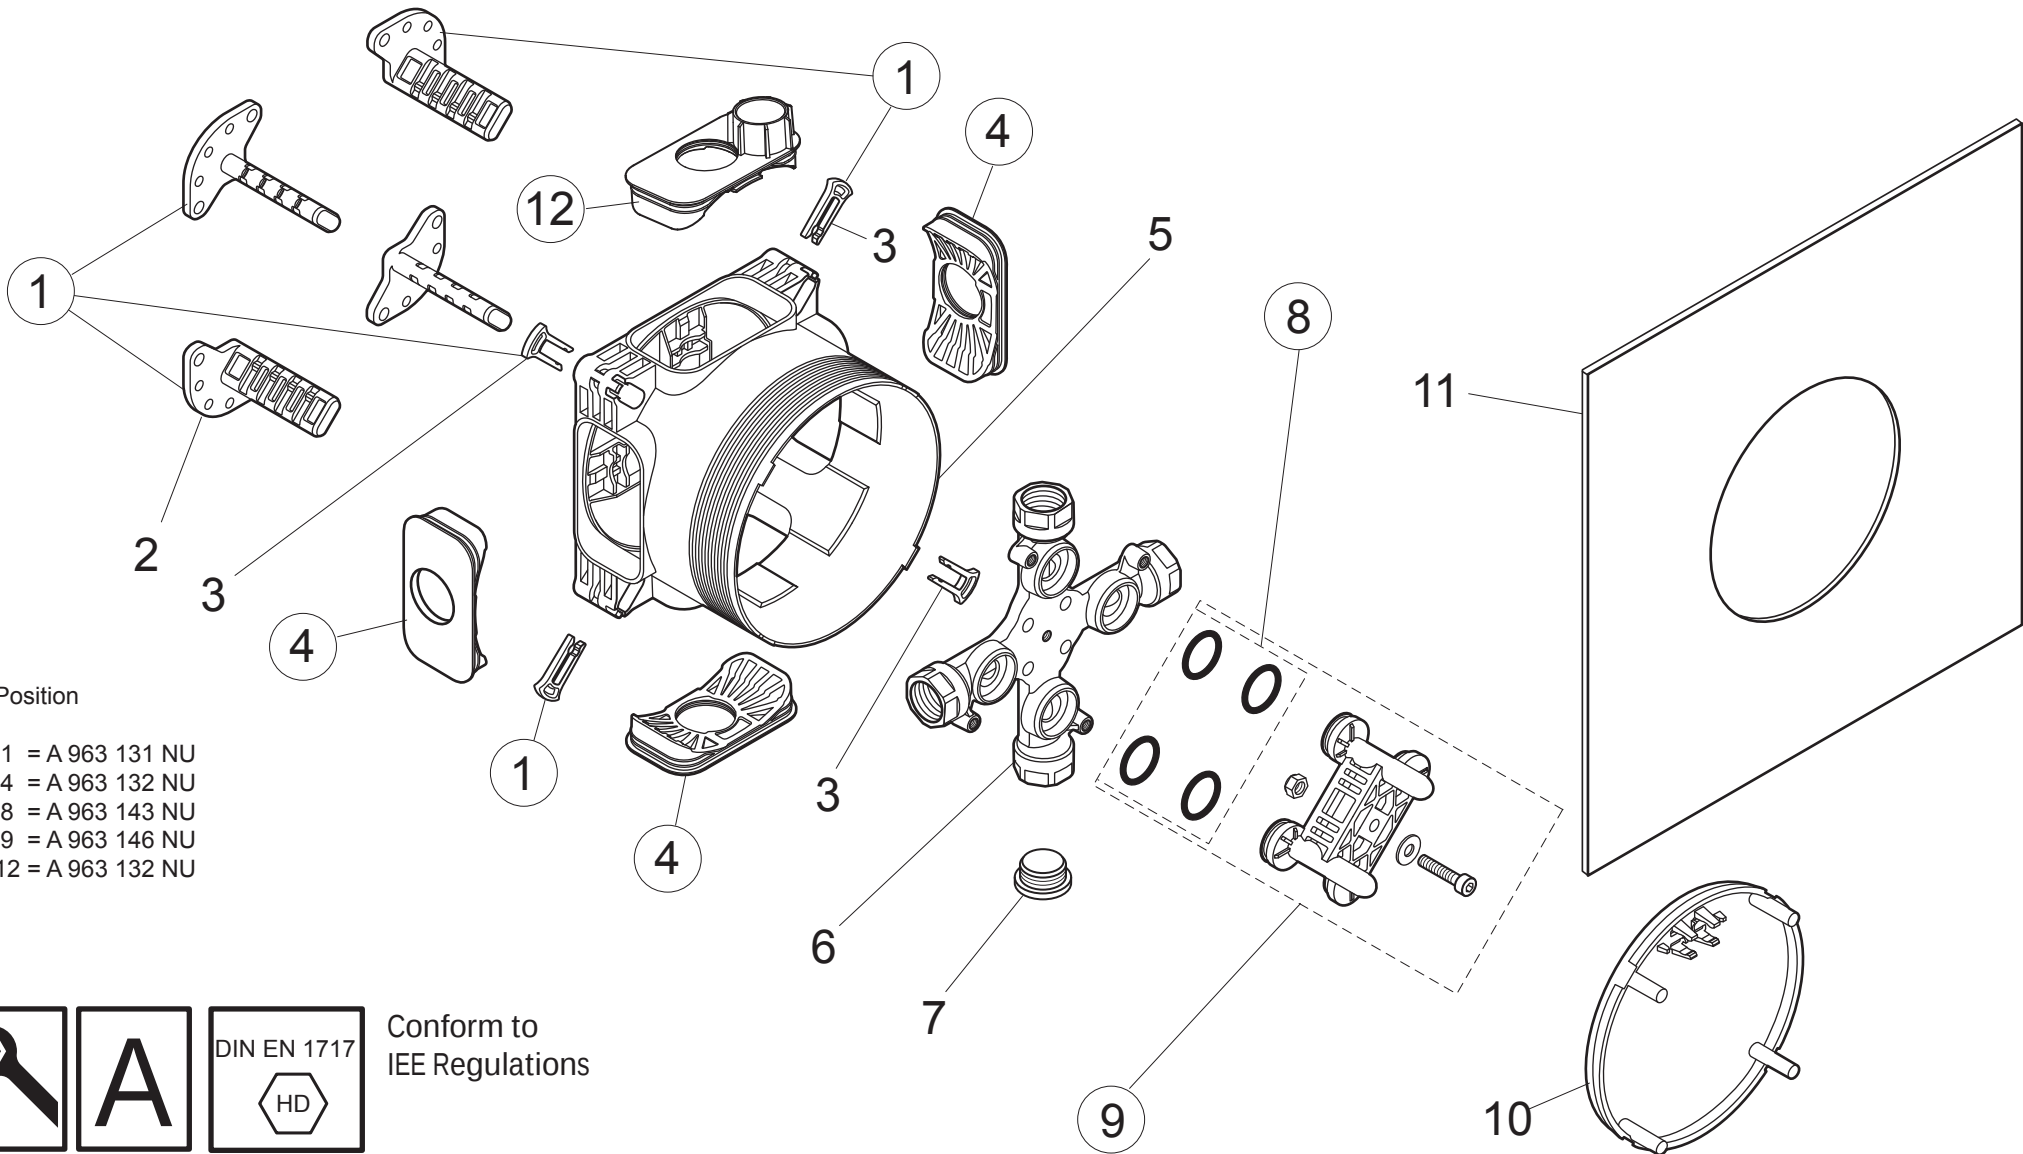

Position


- 1 = A 963 131 NU
- 4 = A 963 132 NU
- 8 = A 963 143 NU
- 9 = A 963 146 NU
- 12 = A 963 132 NU



A

DIN EN 1717
HD


Conform to
IEE Regulations




IEC 60364




B1




B2



For compliance with IEE regulations
Mount transformer in a junction / connection box
in an „outside zone“ typically behind the panel.
An example being a 90x90x50 IP X5 or better.




IEC 60364

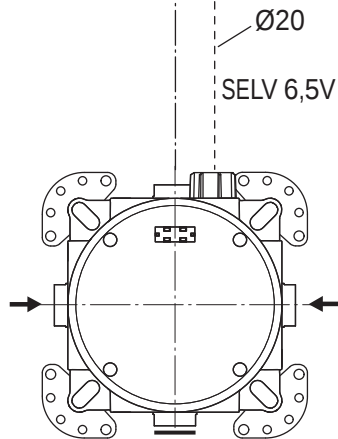

Armitage
Shanks

EASY BOX
A 1000 NU

0517/ A 866 935
Made in Germany

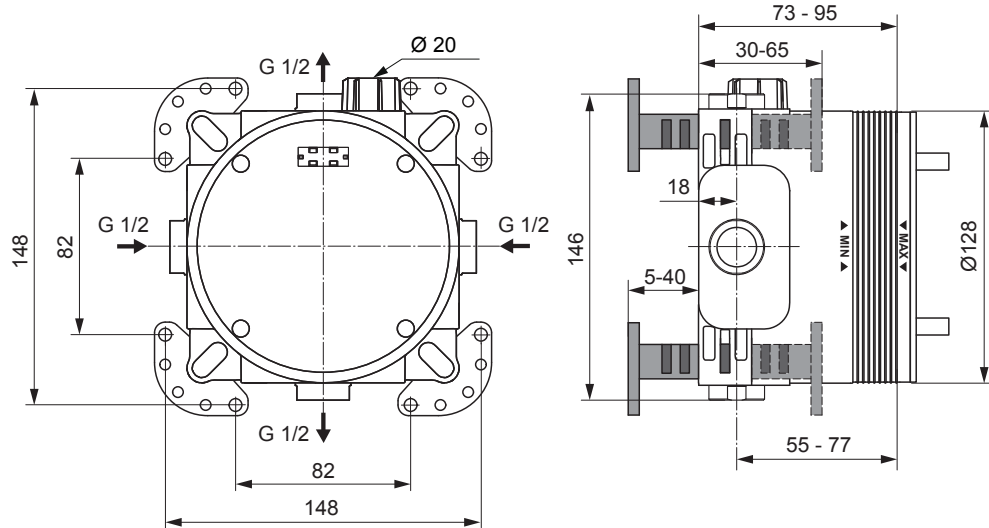

Ideal Standard International NV
Corporate Village - Gent Building
Da Vincilaan 2
1935 Zaventem
Belgium

www.idealstandardinternational.com

